


# Masoneilan FVP® 110 Fieldbus Valve Positioner


Specification Data

CW4000

09/06

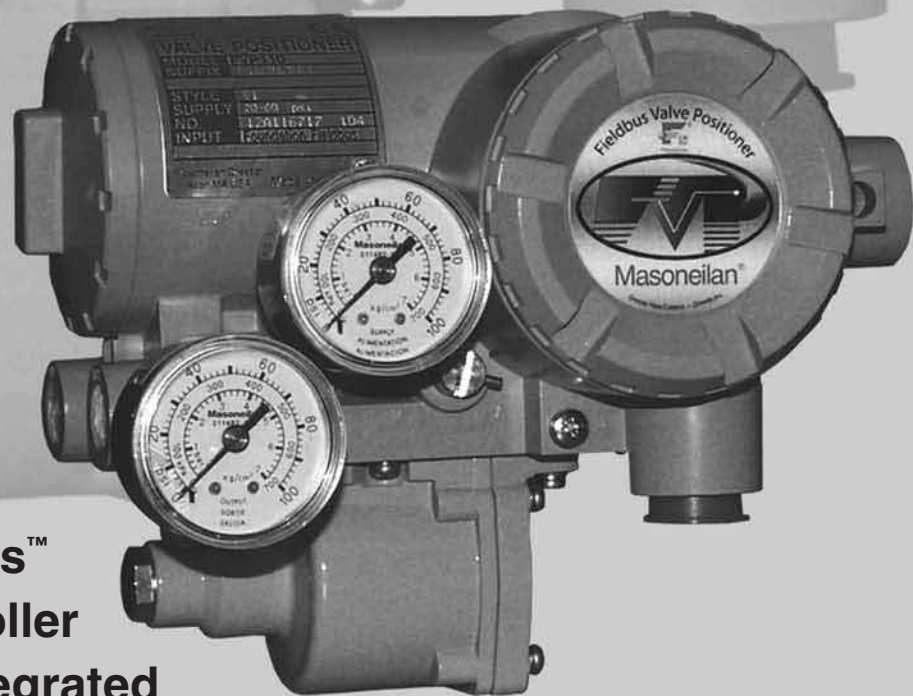

**FOUNDATION Fieldbus™  
Positioner and Controller  
Interoperable and Integrated  
Single & Double-Acting**



[www.masoneilan.com](http://www.masoneilan.com)

Masoneilan's FVP® positioner, certified and approved by Fieldbus™ Foundation, can be used in conjunction with all certified Foundation Fieldbus™ Host systems. Within the FF host system, certified device descriptors (DD) enable seamless integration *and* interoperability of the Masoneilan FVP positioner. The Masoneilan FVP positioner has unequalled “on-board” data gathering capabilities, alarms, and diagnostics as well as standard positioner functionality. The Masoneilan FVP as advanced diagnostics integration and automated valve data analysis available with leading asset management software. Further enhanced capabilities of graphical data manipulation and valve signature acquisition are accomplished with Masoneilan's ValVue® FF software program, which may be used either as a standalone program or integrated with major FF host systems.

## Table of Contents

Precise Digital Positioning & Diagnostics.....	2	Alarms .....	8
Masoneilan FVP Overview .....	3	Masoneilan FVP Diagnostics .....	9
Physical and Operational Specifications .....	4	Masoneilan FVP Integration with Host Systems .....	10
Model Numbering System .....	6	Diagnostics Summary .....	11
Optional Specifications.....	6	Fieldbus Specification Data Summary .....	13
Dimensions.....	7	Ease of Setup.....	15
Weights.....	7		

## Precise Digital Positioning & Diagnostics

The Masoneilan FVP is an intelligent digital valve positioner and PID process controller that communicates using the FOUNDATION Fieldbus protocol. The Masoneilan FVP offers advanced control technology for pneumatically actuated valves; provides higher precision, greater flexibility and ease of use. The major advantages of the Masoneilan FVP are:

- High Performance: Can respond to Step Changes of (0.05%)
- Low Power Consumption: (16mA) – Ideal for Intrinsically Safe applications
- Fast Commissioning: User friendly ValVue FF Set-up Wizard and Methods
- Low Life Cycle Cost: Low Air Consumption (< 10 scfh @ 20 psi)
- Self-initiated Valve Alarms
- Diagnostics and software integration possible with virtually all control systems
- On Board Valve Signature & Diagnostics Storage: Easily retrieved diagnostic information
- One Model Fits All: The same unit can be mounted on any manufacturer's rotary or linear actuator
- Manual Pneumatic Override Switch: Bypass electronics for valve installation, commissioning, and diagnosing
- Standard or Advanced Diagnostics: Scalable valve diagnostics to match process application
- Online Firmware Flash: Update Firmware without Process Interruption
- Built in Positioning Autotune: Patented for optimal response regardless of actuator size, can be launched from the control system or any FF configurator
- Frictionless Position Sensor: High resolution and maintenance free
- Modular Design: Makes for a compact and easily maintained and installed positioner
- Single- and Double-Acting models available



# Masoneilan FVP Overview

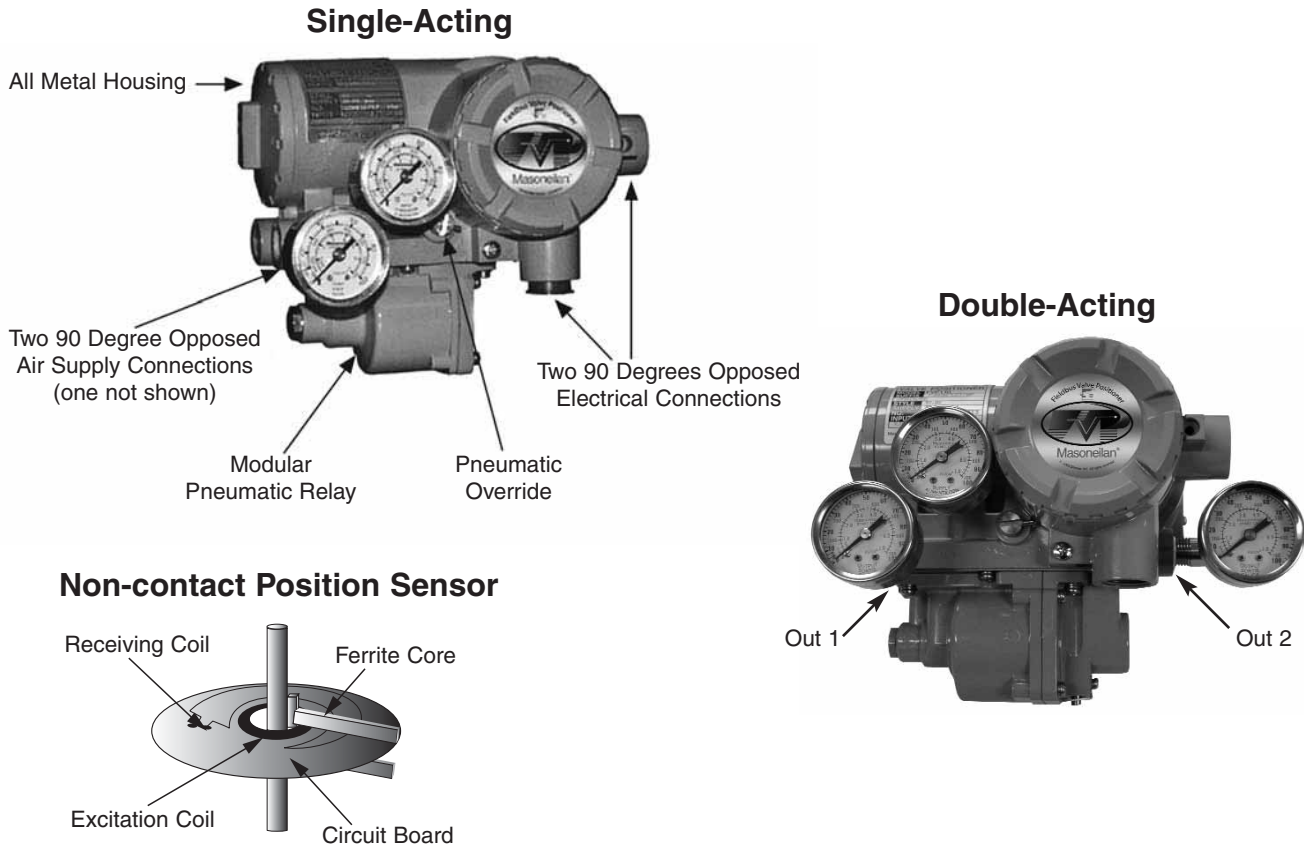


Figure 1: Masoneilan FVP Components

## Multi-Function Blocks = Control Flexibility

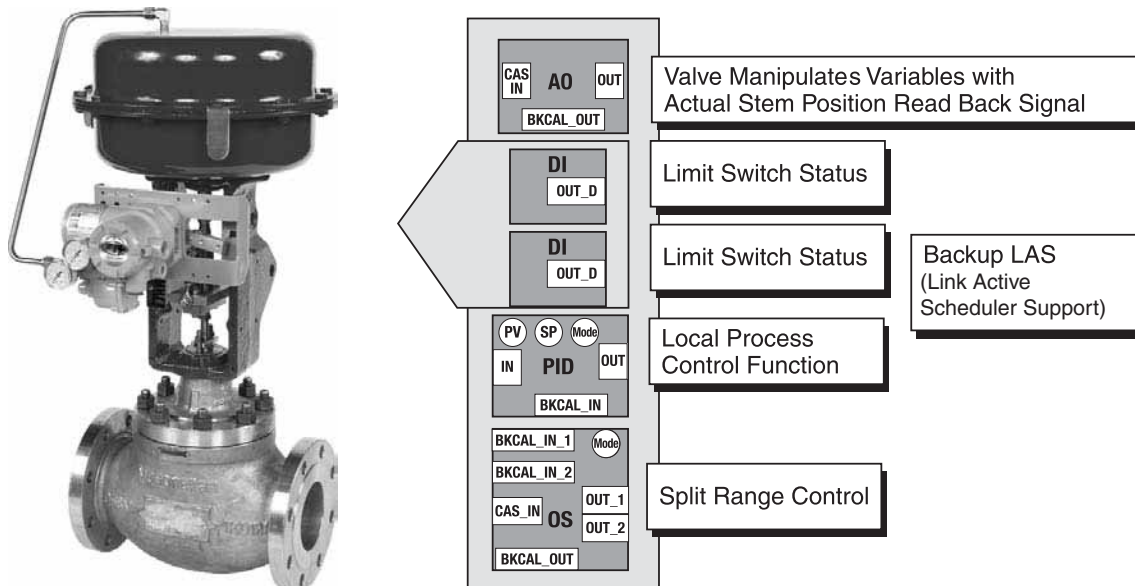


Figure 2: Masoneilan FVP Functional Overview

## Physical and Operational Specifications

Item	Specification
Communication Protocol	FOUNDATION Fieldbus™
Voltage/Capacitance	9 - 32 Vdc / 1.76 nF
Housing Materials	Case: Aluminum die-cast / Paint: Polyurethane resin-baked finish
Weight	Single-Acting = 5.1 lbs (2.3 Kg)
	Double-Acting = 6.2 lbs (2.8 Kg)
Supply Current (Standard)	17mA max (16mA standard)
Supply Current (on-line download version)	17mA (approximately 41mA when flashing firmware)
Action	Single-Acting / Double-Acting
Connections	Pneumatic 1/4 NPT Female
	Electrical 1/2 NPT Female (other options available)
	Gauges 1/8 NPT
External Pneumatic Auto/Manual Switch	Included
Position Sensor Span	Rotary Travel 20 - 90° Linear Travel 0.4 - 6 inches (10 - 152mm) <sup>(1)</sup>
Operating Temperature Limits	Single-Acting = -40°F to 185°F (-40°C to 85°C) Double-Acting = -40°F to 140°F (-40°C to 60°C)
Enclosure Rating	IP65, NEMA4X
Linearity	+/-0.5%
Hysteresis	0.3%
Dead Band	0.1%
Supply Pressure	Single-Acting = 20 - 100 PSI (1.4 - 6.9 bar) Double-Acting = 30 - 105 PSI (2 - 7 bar)
Air Consumption	Single-Acting = 0.32 m <sub>3</sub> /h at 20 PSI (1.4 bar) Double-Acting = 0.508 SCFM (0.915 Nm <sub>3</sub> /h)
Air Delivery	Single-Acting = 6.6 m <sub>3</sub> /h at 20 PSI (1.4 bar) Double-Acting = 11.7 SCFM (18.85 Nm <sub>3</sub> /h)
Temperature Effect	+/- 0.04% of F.S./°F (+/-0.08% of F.S./°C)
Lightning Protection (Optional)	Max current 6000 A (rise 1 micro second, fall 40 micro seconds) Repeating current 1000 A (rise 1 micro second, fall 40 micro seconds) 100 times
Ambient Humidity Limits	5 to 95% RH at 104°F (40°C)
Vibration Limit	4 mm at 5 to 15 Hz / 2G at 15 to 2000 Hz
Shock Limit	10G
Flow Characterization	Linear, Equal Percentage (50:1 and 30:1), Quick Opening, Camflex Eq% User Defined, Tight Shut-off and Full Open
Valve Position Auto Tune	Masoneilan FVP performs an automatic determination of the optimal valve position control parameters (during setup).
On-line Firmware Download	Optional
Backup Link Active Scheduler	Standard

1. Above 6 inches can be achieved with custom mounting. Consult factory for mounting details.

**Table 1: Masoneilan FVP Specifications**

## Physical and Operational Specifications

Item	Specification
Function Blocks Included	PID, AO, DI X 2: and OS (splitter block)
Positioner Alarms	Block Alarm, Process Alarm, and Event Update Each alarm provides detailed information
Fail Safe Action	Internal diagnostics and configurable deviation alarm can set output pressure to zero
Diagnostics	Standard or Advanced (see pages 8 & 9)
ITK (consult <a href="http://www.fieldbus.org">www.fieldbus.org</a> for latest updates)	4.61

**Table 1: FVP110 Specifications (cont.)**

Item	Specification	Code	
ATEX	Flame Proof  Per EN 50014 (1997) and EN 50018 (2000) Group: II Category: 2G EEx d IIC T6, ambient Temp.: -40 to 167°F (-40 to 75°C) EEx d IIC T5, ambient Temp.: -40 to 176°F (-40 to 80°C)	KF2	
ATEX	Intrinsically Safe  Per EN 50014 (1997), EN 50020 (2002), EN 50284 (1999), EN60529 (1991), and EN50281-1-1 (1998)  Group: II Category : 1GD, 1G or 1D  Maximum Surface Temp for dust proof: 212°F (100°C) Ambient Temp for 1G: -40 to 140°F (-40 to 60°C) Ambient Temp for 1D: -40 to 176°F (-40 to 80°C) Ambient Temp for 1GD: -40 to 140°F (-40 to 60°C)	KS25	
	Gas Proof/Dust Proof		EEx ia IIC T4 EEx ia IIB T4
ATEX	Type n  Group: II, Category: 3G	Consult Factory	
Factory Mutual Approvals	Explosion Proof	Class I, Division 1, Groups B, C and D	FF1
	Intrinsically Safe and Explosion Proof	Class I, II, III Division 1, Groups A, B, C D, E, F and G	FS15
	Non-incendive	Class 1, Division 2, Groups A, B, C and D Suitable for Class II, Division 2, Groups F and G and Class III with Non-incendive Field Wiring applications Hazardous (Classified)	FN15
CSA Approvals	Explosion Proof	Class I, Division 1, Groups B, C and D	CF1
	Intrinsically Safe	Ex ia IIB/IIC T4; Tamb = -58 - 140°F (-50 to 60°C); CSA Enel Type 4X; IP66	CS15
JIS Approvals	Explosion Proof	Class I, Division 1, Groups B, C and D	JF3
	Intrinsically Safe		JS3
CE Conformity	Yes per EN61326		

Note: Intrinsically safe approvals per FISCO.

**Table 2: Agency Approvals**

## Model Numbering System

Table 3 (below) describes the Masoneilan FVP model numbering system and features. For example, Masoneilan FVP model number *FVP110-F1A1/LC1/BP/FF1* indicates: Foundation Fieldbus input signal, is intended for a Single-Acting Actuator, has a PID Function Block, Pressure Sensor and Diagnostics and meets FM Explosion Proof Agency Certification.

Model	Suffix Codes	Description
FVP110		
Input Signal	-F	Foundation Fieldbus
Applicable Actuator	1	Single-Acting Actuator
	2	Double-Acting Actuator. See price sheet for an example.
-	A	Always A
Connection	3	Electrical Connection: 1/2NPT, Pneumatic Connection: 1/4NPT
	6	Electrical Connection: M20, Pneumatic Connection: Rc 1/4"
	N	
Option Codes	/	Optional Specifications (see table below for codes and descriptions)


**Note:** 0-100 psi (0-7 bar) pressure gauges for OUTPUT and SUPPLY are provided as standard.

## Optional Specifications

Item	Description	Code
Lightning protection	Power supply 10.5 to 32 V DC Allowable current Max.6000A(1*40μS), repeating 1000A(1*40μS) 100 times	A
Coating Change	Epoxy resin coating	X1
PID Function Block, Link master function		LC1
Output pressure detecting function, Signature function	Advanced Diagnostics	BP
High Temperature (for Double-Acting Only)	+14°F to +180°F (-10°C to +85°C) ambient temperature	HT
FF Firmware Download Function (Not available for Intrinsic Safety)	Online Firmware Upgrade	EE
FM Explosion proof	See Table 2	FF1
FM Intrinsic Safety	See Table 2	FS15
FM Non incandive	See Table 2	FN15
CSA Explosion proof	See Table 2	CF1
CSA Intrinsic Safety	See Table 2	CS15
ATEX Type N Consult Factory	See Table 2	KN25
ATEX (KEMA) Flame Proof Approval	See Table 2	KF2
ATEX (KEMA) Intrinsic Safety Approval	See Table 2	KS25


**Table 3: Masoneilan FVP Model Nomenclature**

# Dimensions and Weights

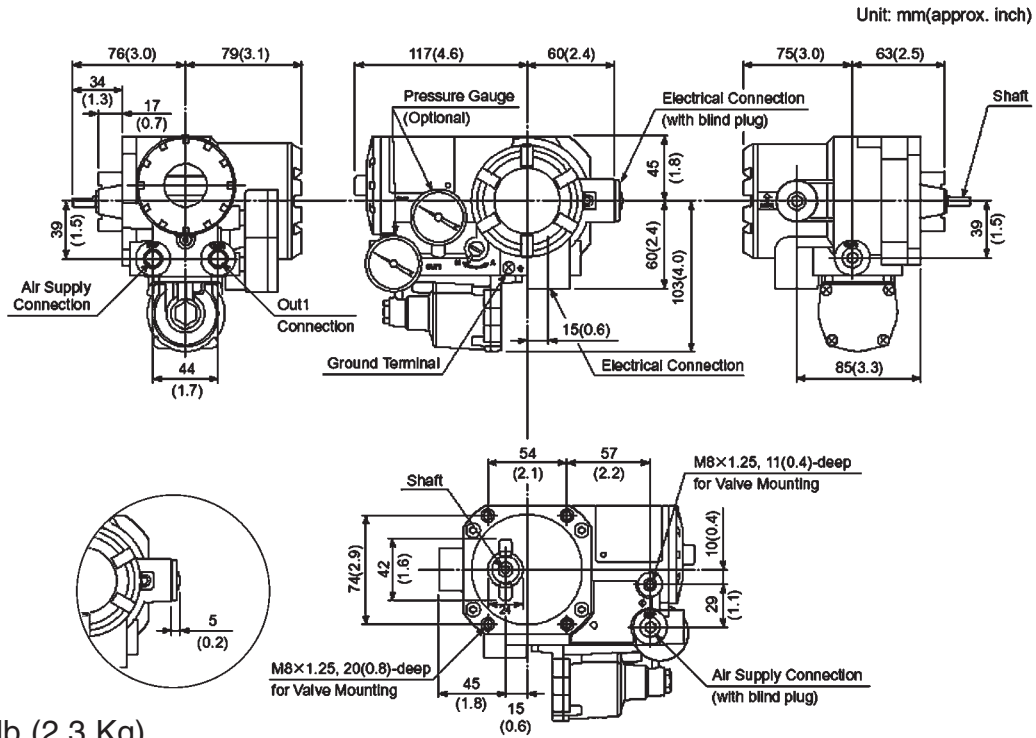

**Weight:** 5.1 lb (2.3 Kg)

**Figure 3: Masoneilan FVP Dimensions (Single-Acting)**

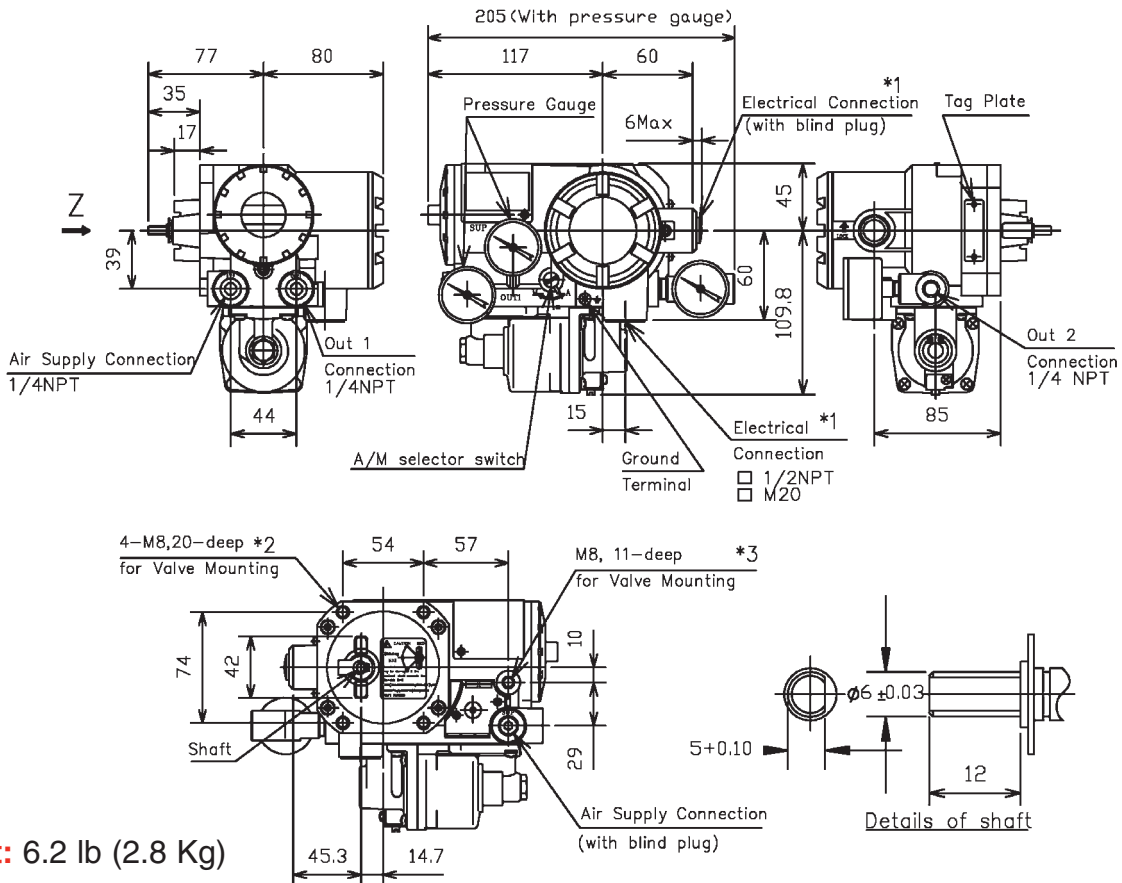

**Weight:** 6.2 lb (2.8 Kg)

**Figure 3: Masoneilan FVP Dimensions (Double-Acting)**

## Alarms

Control Valve Related Runtime Alarms	Diagnostics Option	
	Standard	Advanced / BP
Temperature Sensor Failure	X	X
Pressure Sensor Failure		X
Position Sensor Failure	X	X
A/D Converter Failure (Position Sensor)	X	X
EEPROM Failure	X	X
Amplifier Failure	X	X
Failsafe	X	X
Temperature Measurement Out of Range	X	X
Pressure Measurement Out of Range		X
Position Sensor Out of Range	X	X
Adjustable Hi-Lo Servo Drift Warning	X	X
Cycle Count Limit Exceeded	X	X
Travel Limit Exceeded	X	X
Total Time Open Limit Exceeded	X	X
Total Time Closed Limit Exceeded	X	X
Total Time Near Closed Limit Exceeded	X	X
Deviation Warning	X	X
Deviation Error	X	X
<b>Calibration Related Feedback / Alarms</b>		
Auto Tune / Travel Calibration Error	X	X
Exhaust Air Press Warning		X
Small Air Supply Warning		X
Large Air Supply Warning		X
Offset Drift Warning	X	X
Large Response Speed Warning	X	X
Large Hysteresis Warning	X	X
Large Slip Width Warning	X	X
Small Angle Span Warning	X	X
Large Angle Span Warning	X	X
50% Angle Warning	X	X
Small Angle Span Error	X	X
Large Angle Span Error	X	X
50% Angle Error	X	X
Linear Adjustment Error	X	X
Offset Measurement Failed	X	X
Gain Measurement Failed	X	X
Response Speed Measurement Failed	X	X
Hysteresis Measurement Failed	X	X




# Masoneilan FVP Diagnostics

The Masoneilan FVP has two levels of diagnostics: **Standard** or **Advanced**. The **standard diagnostics version** provides Fieldbus Alarms (see page 8).

The **advanced diagnostics version** provides more in depth calculations (friction, spring range, etc) using a built in pressure sensor (see examples below). This version also provides a means of measuring online friction as well as the dynamic performance of the valve without disturbing the process.

## Positioner Signature (Stored on PC)

Travel vs Setpoint

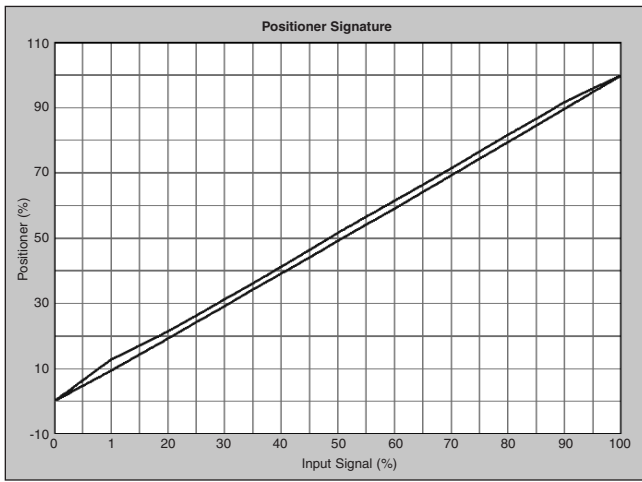


### Analysis

- Hysteresis
- Accuracy
- Overall "Picture"
- Deadband
- Linearity

## Standard Actuator Signature (Stored in the Masoneilan FVP or PC)

Travel vs Actuator Pressure

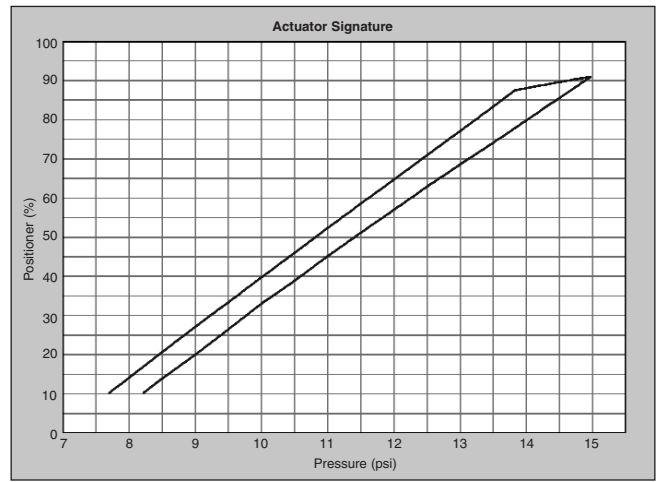


### Analysis

- Friction
- Stick-Slip Width
- Spring Range
- Actuator Pressure

## Step Signature (Stored on PC)

Travel & Setpoint vs Time

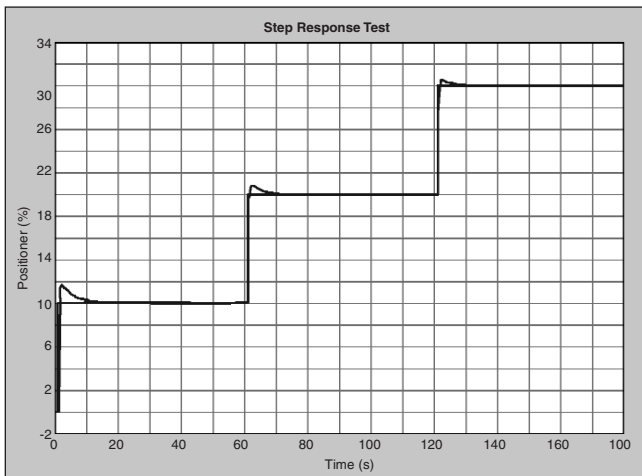


### Analysis

- T86
- Resolution
- Overshoot
- Dead Time

## Extended Actuator Signature (Stored on PC)

Travel vs Actuator Pressure

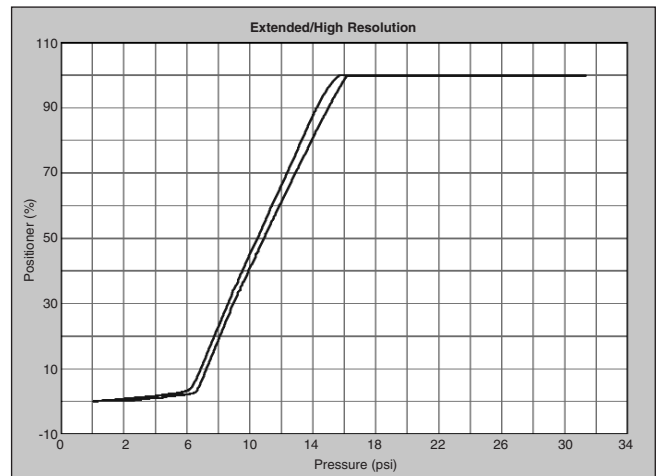




### Analysis

- Friction
- Stick-Slip Width
- Seating Analysis
- Spring Range
- Actuator Pressure

Figure 4: Masoneilan FVP Diagnostics, Graphs

## Masoneilan FVP Integration With Host Systems

Table 4 below provides a summary of the possible Masoneilan FVP and Host System integration configurations.

	<b>Certified &amp; Approved FF Host System With Advanced Diagnostics Integration <sup>(3)</sup></b>			<b>All Certified &amp; Approved Foundation Fieldbus Host Systems</b>
	<b>Honeywell</b>	<b>Emerson</b>	<b>Yokogawa</b>	
	Experion™ PKS	Emerson DeltaV™	Yokogawa CS 1000 CS 3000 STARDOM™	
<b>Configuration – Calibration – Diagnostics</b>				
Diagnostics Integration	Yes <sup>(1)</sup> FVP Scout®	Yes <sup>(2)</sup> AMS™	Yes <sup>(4)</sup> PRM	Consult Masoneilan
Configuration / Calibration Using Menus, Methods & Setup Wizards	Yes <sup>(4)</sup>	Yes <sup>(4)</sup>	Yes <sup>(4)</sup>	Yes
Configuration / Calibration via Host	Yes	Yes	Yes	Yes
Asset Management Support	Yes <sup>(1)</sup> FVP Scout	Yes <sup>(2)</sup> AMS	Yes <sup>(4)</sup> PRM	Consult Masoneilan
Configuration / Calibration via Host	Yes	Yes	Yes	Yes
Configuration / Calibration / Diagnostics via ValVue FF Standalone connected to H1 Segment	Yes	Yes	Yes	Yes
				
Configuration / Calibration / Diagnostics via Integrated Package				
	Yes <sup>(1)</sup>	Yes <sup>(2)</sup>	Yes	Consult Factory
Name of Add-On Package	Pending	AMS ValVue FF SNAP-ON™	ValVue FF PRM Plug-In	N/A

1. Asset Manager Fault Models for FVP.





2. Emerson Delta V AMS SNAP-ON for ValVue FF.

3. At Time of Print. For other systems contact Masoneilan.

4. Device Type 1, Rev 3 or Type 7 only

**Table 4: Masoneilan FVP - Host Integration**

## Diagnostics Summary

Diagnostic Item	Diagnostics Version		Accessibility Read and Write (if applicable)			Device Initiated
	Standard	Advanced /BP Option	Host System (TB Block and menus-and-methods)	FF Handheld (TB Block and menus-and-methods)	ValVueFF	
						Minimal or No Highway Loading <sup>(2)</sup>
<b>Diagnostics Tests</b>						
Self check including auto-analysis of spring range, low and high air supply, valve hysteresis, time constant, and stick-slip	✓*	✓	✓	✓	✓	✓
Standard Actuator Signature test with automatic friction, and spring range analysis <sup>(4)</sup>		✓	✓	✓	✓	✓
On board non-volatile memory storage for two actuator signatures with analysis <sup>(4)</sup>		✓	✓	✓	✓	✓
Extended actuator test with automatic friction, spring, and seating analysis <sup>(4)</sup>		✓			✓	✓
High resolution extended actuator test with automatic friction, spring, and seating analysis <sup>(4)</sup>		✓			✓	N/A
Positioner performance signature (positioner signature)		✓			✓	✓
Valve/Actuator/Positioner performance signature (step test)		✓			✓	✓
Online performance analysis including friction	✓ <sup>(3)</sup>	✓			Consult Factory	
<b>Signature Handling</b>						
Comparative signature overlay and analysis of 8 tests	N/A	N/A	✓ <sup>(1)</sup>		✓	N/A
Trending window of diagnostic test progress can be saved	N/A	N/A	✓ <sup>(1)</sup>		✓	N/A
Batch operation for diagnostic tests	N/A	N/A	✓ <sup>(1)</sup>		✓	N/A
HTML report	N/A	N/A	✓ <sup>(1)</sup>		✓	N/A

1. This feature is host system dependent. See table “Integration with control systems” for more details, page 10.

2. Diagnostic tests or calibration routines, which are “device initiated” and running within the micro-processor of the Masoneilan FVP. Therefore, minimal or no communication bandwidth is affected, which allows for successful completion of these tasks without sacrificing the H1 segment throughput.





3. Friction related information not available.

4. Not available with Double-Acting.

\* Spring Range, Air Supply Not Available

**Table 5: Diagnostics Summary**

# Diagnostics Summary

Diagnostics Item	Diagnostics Version		Accessibility Read and Write (if applicable)			Device Initiated
	Standard	Advanced /BP Option	Host System (TB Block and menus-and-methods)	FF Handheld (TB Block and menus-and-methods)	ValVueFF	
	Standard	Advanced /BP Option				Minimal or No Highway Loading <sup>(2)</sup>
<b>Valve Historian</b>						
32 bit cycle counter with adjustable alarm threshold	✓	✓	✓	✓	✓	✓
32 bit Travel accumulator with adjustable alarm threshold	✓	✓	✓	✓	✓	✓
Accumulating timer of valve position “closed” with adjustable alarm threshold	✓	✓	✓	✓	✓	✓
Accumulating timer of valve position “near closed” with adjustable alarm threshold	✓	✓	✓	✓	✓	✓
Accumulating timer of valve position “open” with adjustable alarm threshold	✓	✓	✓	✓	✓	✓
<b>FVP Self Initiated Diagnostics</b>						
Impending positioner or control valve problem (servo alarm)	✓	✓	✓	✓	✓	✓
Control valve position deviation from commanded setpoint	✓	✓	✓	✓	✓	✓
Sensor failures (position, temperature, A/D converter, etc)	✓	✓	✓	✓	✓	✓
CPU tasks, memory integrity, communication integrity	✓	✓	✓	✓	✓	✓
<b>Setup and Calibration Diagnostics</b>						
Auto-Calibration with 9 pass-fail criteria	✓	✓	✓	✓	✓	✓
Positioning AutoTune with 11 pass-fail criteria	✓	✓	✓	✓	✓	✓

1. This feature is host system dependent. See table “Integration with control systems” for more details, page 10.
2. Diagnostic tests or calibration routines, which are “device initiated” and running within the micro-processor of the Masonellan FVP. Therefore, minimal or no communication bandwidth is affected, which allows for successful completion of these tasks without sacrificing the H1 segment throughput.
3. Friction related information not available.

**Table 5: Diagnostics Summary (cont.)**

# Fieldbus Specification Data Summary


1. General		
	Is the device registered at the Fieldbus Foundation (Y/N)	Yes
	Manufacturer Name	Dresser Masoneilan
	Manufacturer ID	445644
	Model	FVP110
	Device Type/Rev	1/4
		7/2
	ITK (See www.fieldbus.org for latest updates)	4.61
2. DD and CFF		
	Device Description File Name (.ffo and .sym)	Type 1: 0401.FFO, 0401.SYM
		Type 7: 0202.FFO, 0202.SYM
	Capabilities File Name	Type 1: 040101.CFF
		Type 7: 040101.CFF
	List of Methods	Setup Wizard
		Auto Tuning
		Travel Calibration
		Operational Configuration
		Search Stop Points
		Control Parameter Tuning
		Self Check Execution
		Release Fail Safe
		Signature Execution
		Upload Signature Data
	Upload Signature Header Data	
	Instant Troubleshooting	
3. Physical		
3.1	Polarity Sensitive (Y/N)	Yes
3.2	Quiescent Current Draw (mA)	16
3.3	Startup Current Draw (ma)	17
3.4	Capacitance	176nF
3.5	4-wire Device	No
4. Communication		
4.1	Stack Manufacturer	Yokogawa/Softing
4.2	Does the Device support Backup LAS functionality?	Yes
	Total Number of VCRs	29
4.3	Number of Fixed VCRs for user configuration (Publisher, Subscriber, Alarming, and Trending)	QUB/Server-3
		QUU/Source(Alert)-1
		QUU/Source(Trend)-1
		BNU/Publisher - 11
		BNU/Subscriber - 12

## Fieldbus Specification Data Summary (cont'd)


5. User Layer General		
5.1	Function Block Application Manufacturer	Yokogawa
5.2	Function Blocks (list all type, but not including transducer)	AO, PID, DI, OS
5.3	Device Support Block Instantiation (Y/N)	No
5.4	Number of Link Objects	25
5.5	Device Support firmware upgrade over fieldbus segment? (Y/N)	Yes (optional)
6. Resource Block		
6.1	Block Class (Standard, Enhanced, Custom)	Standard
6.2	Special Features	No
7. Transducer Blocks		
7.1	Block Class (Standard, Enhanced, Custom)	Custom
7.2	Does the device support methods in the Resource and Transducer Blocks?	Yes
7.3	Special Features besides Methods (multiple views, etc.)	Yes
7.4	Transducer Block Special Features (supports Methods, multiple VIEWS, etc.)	Multiple VIEWS
8. Function Blocks		
8.1	Does the Device support Custom Function Blocks?	No
8.2	Block Type	DI1, DI2, OS, PID, AO
8.3	Number Available	5 (RB and TB not included)
8.4	Execution Time (ms)	AO: 95 ms, PID: 120 ms, OS: 95 ms, DI1 & DI2: 40 ms
8.5	Block Class (Standard, Enhanced, Custom)	Standard
8.6	Is the AO block of the device (e.g. Positioner Type) able to operate in Cascade mode?	Yes
9. Channels		
	XD_SCALE and CHANNEL value	Listed by Channel, Unit Code, Enumerated Description, and Function Block Type
9.1	Channel 0	PID Controlled Value Input
9.2	Channel 1	Analog
		Input/Output
		Set point and readback signals
9.3	Channel 2	Discrete output High limit switch status
9.4	Channel 3	Discrete output Low limit switch status

## Ease of Setup


The Masoneilan FVP is very easy to setup, configure and commission from any FF host, because the (DDs) that reside in the host system contain “menu and methods” to guide the user through the Masoneilan FVP setup. Below are a few examples of the Setup Wizard executed from some commonly used host systems and Masoneilan FVP.

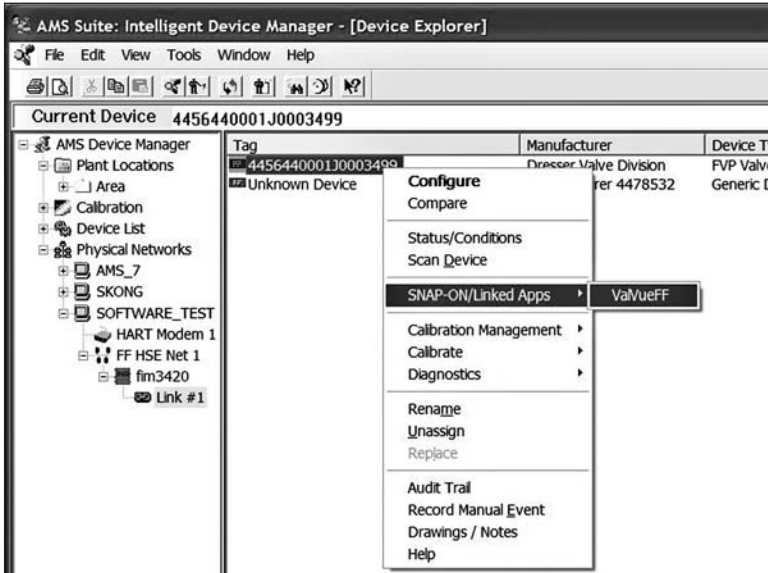


Emerson Process Management integration - ValueFF Snap-On for AMS 7.0, DeltaV 7.2 or later edition

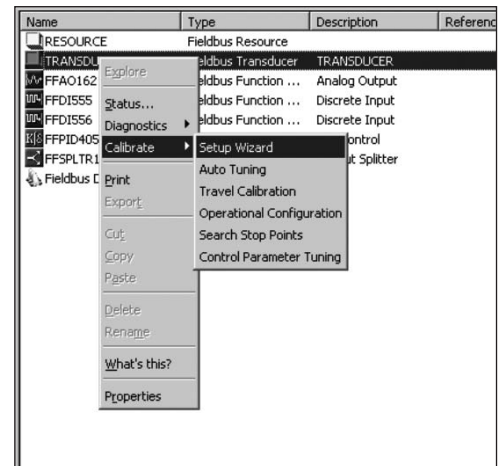

Launching the Setup Wizard by Right-clicking on the TB Block from the DeltaV Explorer

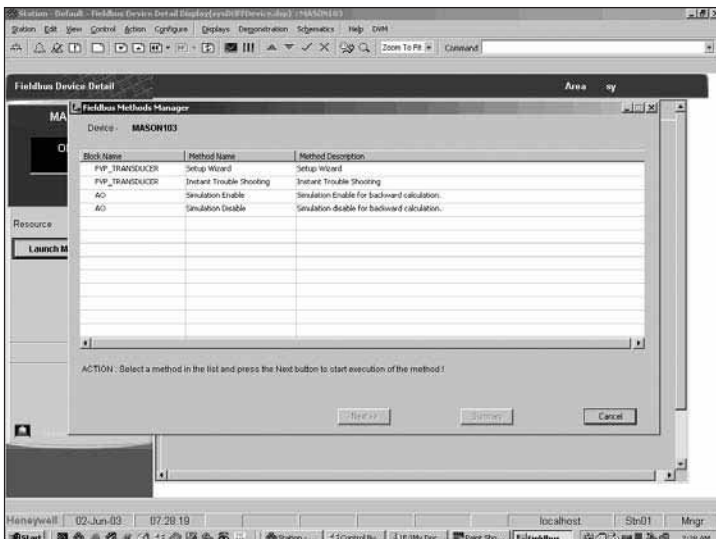

Honeywell ExperionPKS – How to Launch the Setup Wizard from the “Fieldbus Methods Manager”

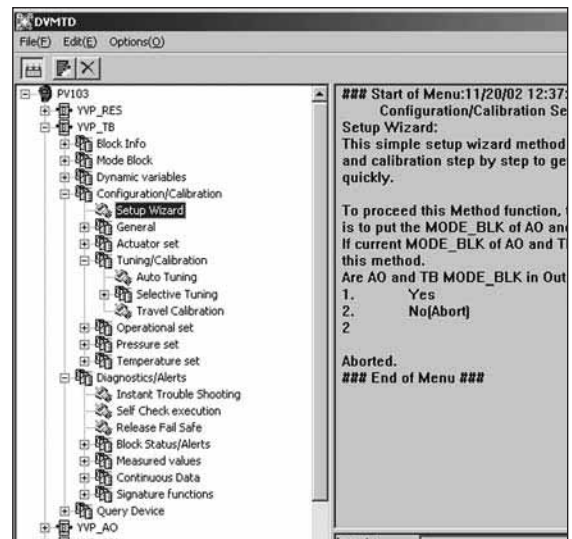

Yokogawa Centum system – How to Launch the Setup Wizard from the “Method Invoker”

FOUNDATION Fieldbus is a registered trademark of Foundation Foundation.  
 Experion and Scout are registered trademarks of Honeywell.  
 STARDOM is a registered trademark of Yokogawa.  
 DeltaV, AMS and SNAP-ON are registered trademarks of Emerson Electric Co.

# Sales Office Locations

## BELGIUM

Dresser Valves Europe  
Boulevard du Souverain 207 B2  
Vorstlaan,  
B-1160 Brussels, Belgium  
Phone: +32-2-344-0970  
Fax: +32-2-344-1123

## BRAZIL

Dresser Industria e Comercio Ltda  
Divisao Masoneilan  
Rua Funchal, 129 - Conj. 5A  
04551-060 - Sao Paulo - SP Brazil  
Phone: 55-11-2146-3600  
Fax: 55-11-2146-3610

## CANADA

Ontario  
Dresser - Masoneilan  
DI Canada, Inc.  
835 Harrington Court, 2nd Floor  
Burlington, Ontario L7N 3P3, Canada  
Phone: 905-335-3529  
Fax: 905-336-7628

## CHINA

Dresser Flow Solutions  
Beijing Rep. Office  
Suite 1703, Capital Mansion  
6 Xinyuannan Rd. Chaoyang District  
Beijing 100004, China  
Phone: +86-10-8486-4515  
Fax: +86-10-8486-5305

## FRANCE

Masoneilan - Dresser Produits  
Industriels  
Energy 5  
130/190 Boulevard de Verdun  
92413 Courbevoie cedex, France  
Phone: +33-1-4904-9000  
Fax: +33-1-4904-9010

Dresser Produits Industriels S.A.S.,  
Masoneilan Customer Service Centre  
55 rue de la Mouche, Zone Industrielle  
69540 Irigny, France  
Phone: +33-4-72-39-06-29  
Fax: +33-4-72-39-21-93

## GERMANY

Dresser Valves Europe GmbH  
Heiligenstrasse 75  
Viersen D-41751, Germany  
Phone: +49-2162-8170-0  
Fax: +49-2162-8170-280

Dresser Valves Europe GmbH  
Umlandstrasse 58  
60314 Frankfurt, Germany  
Phone: +49-69-439350  
Fax: +49-69-4970802

## INDIA

Dresser Valve India Pvt. Ltd.  
305/306, "Midas", Sahar Plaza  
Mathurdas VasANJI Road  
J.B. Nagar, Andheri East  
Mumbai, 400059, India  
Phone: +91-22-8354790  
Fax: +91-22-8354791

Dresser Valve India Pvt. Ltd.  
205, Mohta Building  
4 Bhikaji Cama Place  
New Delhi, 110 066, India  
Phone: +91-11-2-6164175  
Fax: +91-11-5-1659635

## ITALY

Dresser Italia S.r.l.  
Masoneilan Operations  
Via Cassano, 77  
80020 Casavatore, Napoli Italy  
Phone: +39-081-7892-111  
Fax: +39-081-7892-208

## JAPAN

Niigata Masoneilan Co. Ltd. (NIMCO)  
20th Floor, Marive East Tower  
WBG 2-6 Nakase, Mihama-ku,  
Chiba-shi, Chiba 261-7120 Japan  
Phone: +81-43-297-9222  
Fax: +81-43-299-1115

## KOREA

Dresser Korea Inc.  
2109 Kuk Dong Building  
60-1, ChoongMoo-ro 3-ka  
Joong-gu, Seoul, Korea 100-705  
Phone: +82-2-2274-0748  
Fax: +82-2-2274-0720

## KUWAIT

Dresser Flow Solutions  
Middle East Operations  
10th Floor, Al Rashed Complex  
Fahad Salem Street, P.O. Box 242  
Safat, 13003, Kuwait  
Phone: +965-9061157  
Fax: +965-3987879

## MALAYSIA

Dresser Flow Solutions  
Business Suite, 19A-9-1, Level 9  
UOA Centre, No. 19, Jalan Pinang  
50450 Kuala Lumpur, West Malaysia  
Phone: +60-3-2161-0322  
Fax: +60-3-2163-3612

## MEXICO

Dresser Valve de Mexico, S.A. de C.V.  
Henry Ford No. 114, Esq. Fulton  
Fraccionamiento Industrial San  
Nicolas  
54030 Tlalnepantla Estado de Mexico  
Phone: 52-5-310-9863  
Fax: 52-5-310-5584

## THE NETHERLANDS

Dresser Valves Europe  
Steenhouwerstraat 11  
3194 AG Hoogvliet, The Netherlands  
Phone: +31-10-438-4122  
Fax: +31-10-438-4443

## RUSSIA

DS Controls  
Nekhinskaya Street, 61  
Veliky Novgorod  
Russia, 173021  
Phone: +7-8162-15-7898  
Fax: +7-8162-15-7921

## SAUDI ARABIA

Dresser AL Rushaid  
Valve & Instrument Co., Ltd.  
(Darvico)  
P.O. Box 10145  
Jubail Industrial City 31961,  
Saudi Arabia  
Phone: +966-3-341-0278  
Fax: +966-3-341-7624

## SINGAPORE

Dresser Singapore Pte Ltd.  
16 Tuas Avenue 8  
Singapore 639231  
Phone: +65-6-6861-6100  
Fax: +65-6-6861-7172

## SOUTH AFRICA

Dresser Limited  
P.O. Box 2234  
16 Edendale Road  
Eastleigh, Edenvale 1610  
Republic of South Africa  
Phone: +27-11-452-1550  
Fax: +27-11-452-6542

## SPAIN

Masoneilan S.A.  
C/Murcia 39 C  
08830 Sant Boi de Llobregat  
Barcelona, Spain  
Phone: +34-93-652-6430  
Fax: +34-93-652-6444

## UNITED ARAB EMIRATES

Dresser Flow Solutions  
Middle East Operations  
P.O. Box 61302  
Roundabout 8  
Units JA01 & JA02  
Jebel Ali Free Zone  
Dubai, U. A. E.  
Phone: +971-4-8838-752  
Fax: +971-4-8838-038

## UNITED KINGDOM

DI U.K. Ltd.  
East Gillibrands  
Skelmersdale,  
Lancashire WN8 9TU, England  
Phone: +44-1695-52600  
Fax: +44-1695-52601

DI U.K. Ltd.  
Unit 4, Suite 1.1, Nobel House  
Grand Union Office Park  
Packet Boat Lane  
Uxbridge, Middlesex UB8 2GH  
Phone: +44-1895-454-900  
Fax: +44-1895-454-919

## UNITED STATES

Dresser - Masoneilan  
85 Bodwell Street  
Avon, MA 02322-1190  
Phone: 508-586-4600  
Fax: 508-427-8971

Dresser - Masoneilan  
4841 Leopard Street  
Corpus Christi, TX 78408-2621  
Phone: 361-881-8182  
Fax: 361-881-8246

Dresser - Masoneilan  
Dresser Direct  
1250 Hall Court  
Deer Park, TX 77536  
Phone: 281-884-1000  
Fax: 281-884-1010

Dresser Flow Solutions  
(Contractor Sales)  
16240 Port Northwest Drive  
Houston, TX 77041  
Phone: 832-590-2303  
Fax: 832-590-2529

Dresser - Masoneilan  
12015 Mora Drive, Unit 2  
Santa Fe Springs, CA 90670  
Phone: 562-941-7610  
Fax: 562-941-7810



CW4000 SD - 09/06  
Masoneilan FVP®110  
Fieldbus Valve Positioner